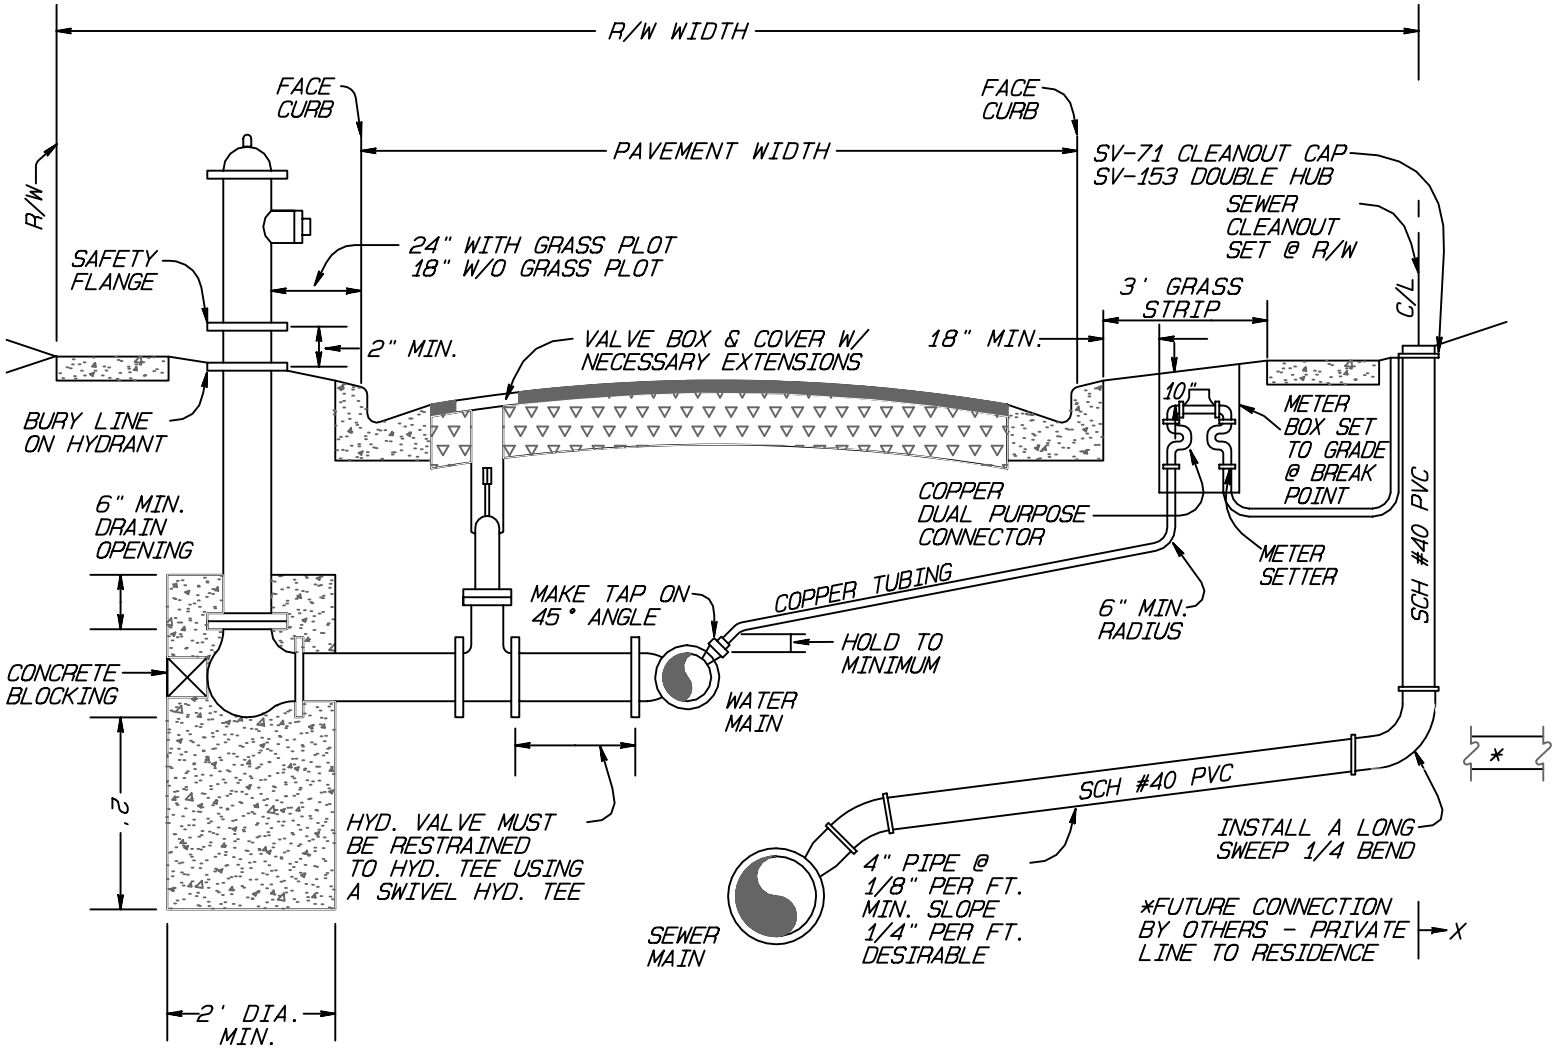

SECTION

NOTES:

5' DESIRABLE MINIMUM FROM PROPOSED TOP OF CURB TO 4" SEWER LATERAL.

THE METER BOX LOCATION MAY BE CHANGED ON WIDENING PROJECTS BY THE ENGINEER.

OPTIONAL (2) MEG-A-LUGS BETWEEN VALVE & HYDRANT INSTEAD OF CONCRETE BLOCKING.

CITY OF GREENSBORO

TYPICAL HOUSE CONNECTION AND HYDRANT SETTING DETAIL

STD. NO.	REV.
101	05-88 06-04 09-95 08-02